



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

BP-Glass Garage Doors & Entry Systems, Inc.
9412 Gidley Street
Tempe City, CA 91780

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Models BP-450 HD/BP-550 SHD Aluminum and Glass Sectional Garage Door up to 24'-2" Wide x 16'-1" Height

APPROVAL DOCUMENT: Drawing No. BPC005, titled "BP-450 HD/BP-550 SHD Glass Garage Door" sheets 1 through 8 of 8, dated 01/13/2012, with revision A dated 10/04/2013, prepared by Building Drops, Inc, signed and sealed by Hermes F. Norero, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: A permanent label with the manufacturer's name or logo, manufacturing address, model number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading 'Miami-Dade County Product Control Approved' is to be located on the door's side track, bottom angle, or inner surface of a panel.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 12-0620.15 and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by Carlos M. Utrera, P.E.



[Signature]
04/15/2014

NOA No. 14-0211.10
Expiration Date: January 17, 2018
Approval Date: April 24, 2014
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **BPC005**, titled "BP-450 HD/BP-550 SHD Glass Garage Door", sheets 1 through 8 of 8, dated 01/13/2012, with revision A dated 10/04/2013, prepared by Building Drops, Inc, signed and sealed by Hermes F. Norero, P.E.

B. TESTS *"Submitted under NOA # 12-0620.15"*

1. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
4) Forced Entry Test, per FBC TAS 202-94
along with installation diagram on three Series/Model BP-450/ BP-550 SHD Hurricane Line, glazed sectional garage doors, prepared by Architectural Testing, Inc, Test Report No. **A6707.01-301-18**, dated 11/22/2011, with Revision 2 dated 06/01/2012, signed and sealed by Tyler Westerling, P.E.

C. CALCULATIONS

1. Product evaluation report prepared by Building Drops, Inc., dated 01/07/2014, signed and sealed by Hermes F. Norero, P.E.

"Submitted under NOA # 12-0620.15"
2. Product evaluation report complying with FBC 2010, prepared by Building Drops, Inc, dated 05/11/2012, signed and sealed by Hermes F. Norero, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of code conformance to 2010 FBC and no financial interest issued by Building Drops, Inc., dated 09/23/2013, signed and sealed by Hermes F. Norero, P.E.

"Submitted under NOA # 12-0620.15"
2. Laboratory compliance letter for Test Report No. **A6707.01-301-18**, issued by Architectural Testing, Inc., dated 11/22/2011, with Revision 2 dated 06/01/2012, signed and sealed by Tyler Westerling, P.E.



04/15/2014

Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 14-0211.10
Expiration Date: January 17, 2018
Approval Date: April 24, 2014

1/7/2014 1:47 PM

z:\projects\bp glass garage doors & entry systems inc\ind-13-0714-13x8 24x16 garage door additional anchor qualification\dwg\BPC005 rev.cdwg

INSTALLATION NOTES:

- ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN UNLESS OTHERWISE STATED.
- THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
- INSTALL INDIVIDUAL INSTALLATION ANCHORS WITHIN A TOLERANCE OF $\pm 1/2$ INCH OF THE DEPICTED LOCATION IN THE ANCHOR LAYOUT DETAIL (I.E., WITHOUT CONSIDERATION OF TOLERANCES). TOLERANCES ARE NOT CUMULATIVE FROM ONE INSTALLATION ANCHOR TO THE NEXT.
- SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER.
- FOR INSTALLATION INTO WOOD FRAMING USE 3/8 INCH LAG SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 3 INCH MINIMUM EMBEDMENT INTO WOOD SUBSTRATE.
- FOR INSTALLATION DIRECTLY INTO CONCRETE/MASONRY, SEE TABLES A-C (SHEET 6) FOR MINIMUM DIAMETER AND MINIMUM EMBEDMENT INFO.
- FOR INSTALLATION THROUGH STEEL STUD, USE 3/8 INCH DIAMETER STEEL BOLTS OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF THREE (3) THREADS OF PENETRATION BEYOND STEEL STRUCTURE.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, AND SIDING.
- INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
- FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
- INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS, AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BY THE ANCHOR MANUFACTURER.
- INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55.
 - CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 2700 PSI.
 - GROUT-FILLED CMU - UNIT STRENGTH CONFORMS TO ASTM C-90 & GROUT CONFORMS TO ASTM C 476. GROUT SHALL HAVE MINIMUM COMPRESSIVE STRENGTH OF 2000 PSI. SEE FBC SECTION 2105.2.2.1.2 (3) FOR GROUTED MASONRY REQUIREMENTS.
 - STEEL - MINIMUM YIELD STRENGTH OF 33 KSI. MINIMUM WALL THICKNESS OF 118 MILS (12 GAUGE)

GENERAL NOTES:

- THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH THE 2010 FLORIDA BUILDING CODE (FBC), INCLUDING HVHZ AND HAS BEEN EVALUATED ACCORDING TO THE FOLLOWING:
 - TAS 201-94
 - TAS 202-94
 - TAS 203-94
- ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE/MASONRY AND 4X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- 4X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
- THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE. IF SITE CONDITIONS CAUSE INSTALLATION TO DEVIATE FROM THE REQUIREMENTS DETAILED HEREIN, A LICENSED ENGINEER OR ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE WITH THIS DOCUMENT.
- APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED ON THIS PRODUCT IN AREAS REQUIRING IMPACT RESISTANCE.
- DOOR FRAME MATERIAL: ALUMINUM 6005-T5
- IN ACCORDANCE WITH THE 2010 FBC SEC. 2003.8.4 DISSIMILAR METALS INCLUDING FASTENERS THAT MAY COME INTO CONTACT WITH ALUMINUM UNIT FRAMING SHALL BE PROTECTED AS DEFINED IN SEC 2003.8.4.2.
- GLASS MEETS THE REQUIREMENTS OF ASTM E 1300-04 GLASS CHARTS. SEE SHEET 3 FOR GLAZING DETAILS.
- EPDM GLAZING GASKET HAS BEEN TESTED IN ACCORDANCE WITH FBC 2411.3.4.
- BP HURRICANE SYSTEM IS PATENTED IN THE USA.


BP-GLASS GARAGE DOORS & ENTRY SYSTEMS, INC.

BP-450 HD/BP-550 SHD HURRICANE LINE GLASS GARAGE DOOR

TABLE OF CONTENTS		
SHEET	REVISION	SHEET DESCRIPTION
1	A	INSTALLATION & GENERAL NOTES
2	A	ELEVATION & ANCHOR LAYOUT
3	A	ASSEMBLY DETAILS & GLAZING DETAILS
4	A	VERTICAL & HORIZONTAL SECTIONS
5	A	HORIZONTAL SECTIONS
6	A	ANCHOR TABLES & BRACKET DETAIL
7	A	COMPONENTS & BILL OF MATERIALS
8	A	COMPONENTS

DESIGN PRESSURE RATING	
DESIGN PRESSURE - ALL SIZES	MISSILE IMPACT RATING
+50.0 / -50.0 PSF*	LARGE AND SMALL MISSILE IMPACT RATED

*REMOVABLE REINFORCEMENT REQUIRED

PRODUCT REVISED
to comply with the Florida
Building Code
Acceptance No 14-0211.10
Expiration Date 2/17/2018
By 
Miami/Dade Product Control


DATE: 01.13.12
DWN BY: JLA
CHK BY: HFN
SCALE: NTS
DWG #: BPC005
SHEET: 1 OF 8




BP-GLASS GARAGE DOORS & ENTRY
SYSTEMS, INC.
9412 GIDLEY STREET
TEMPLE CITY, CA 91780
PH: (626) 442-1716 FX: (626) 579-5320
www.GlassGarageDoors.com

TITLE: BP-450/550 HD
GLASS GARAGE DOOR
PATENTED HURRICANE SYSTEM
INSTALLATION
& GENERAL NOTES
PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
PH: (954) 398-8478 FX: (954) 744-4738

REVISIONS		DATE
NO.	DESCRIPTION	BY
A	ANCHOR OPTIONS ADDED	TJM
		10.4.13


1-27-2014
HESLEY J. KOSBERG, P.E.
FLORIDA E. & NO. 73778
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
FBC CERT. OF AUTHORIZATION NO. 24878

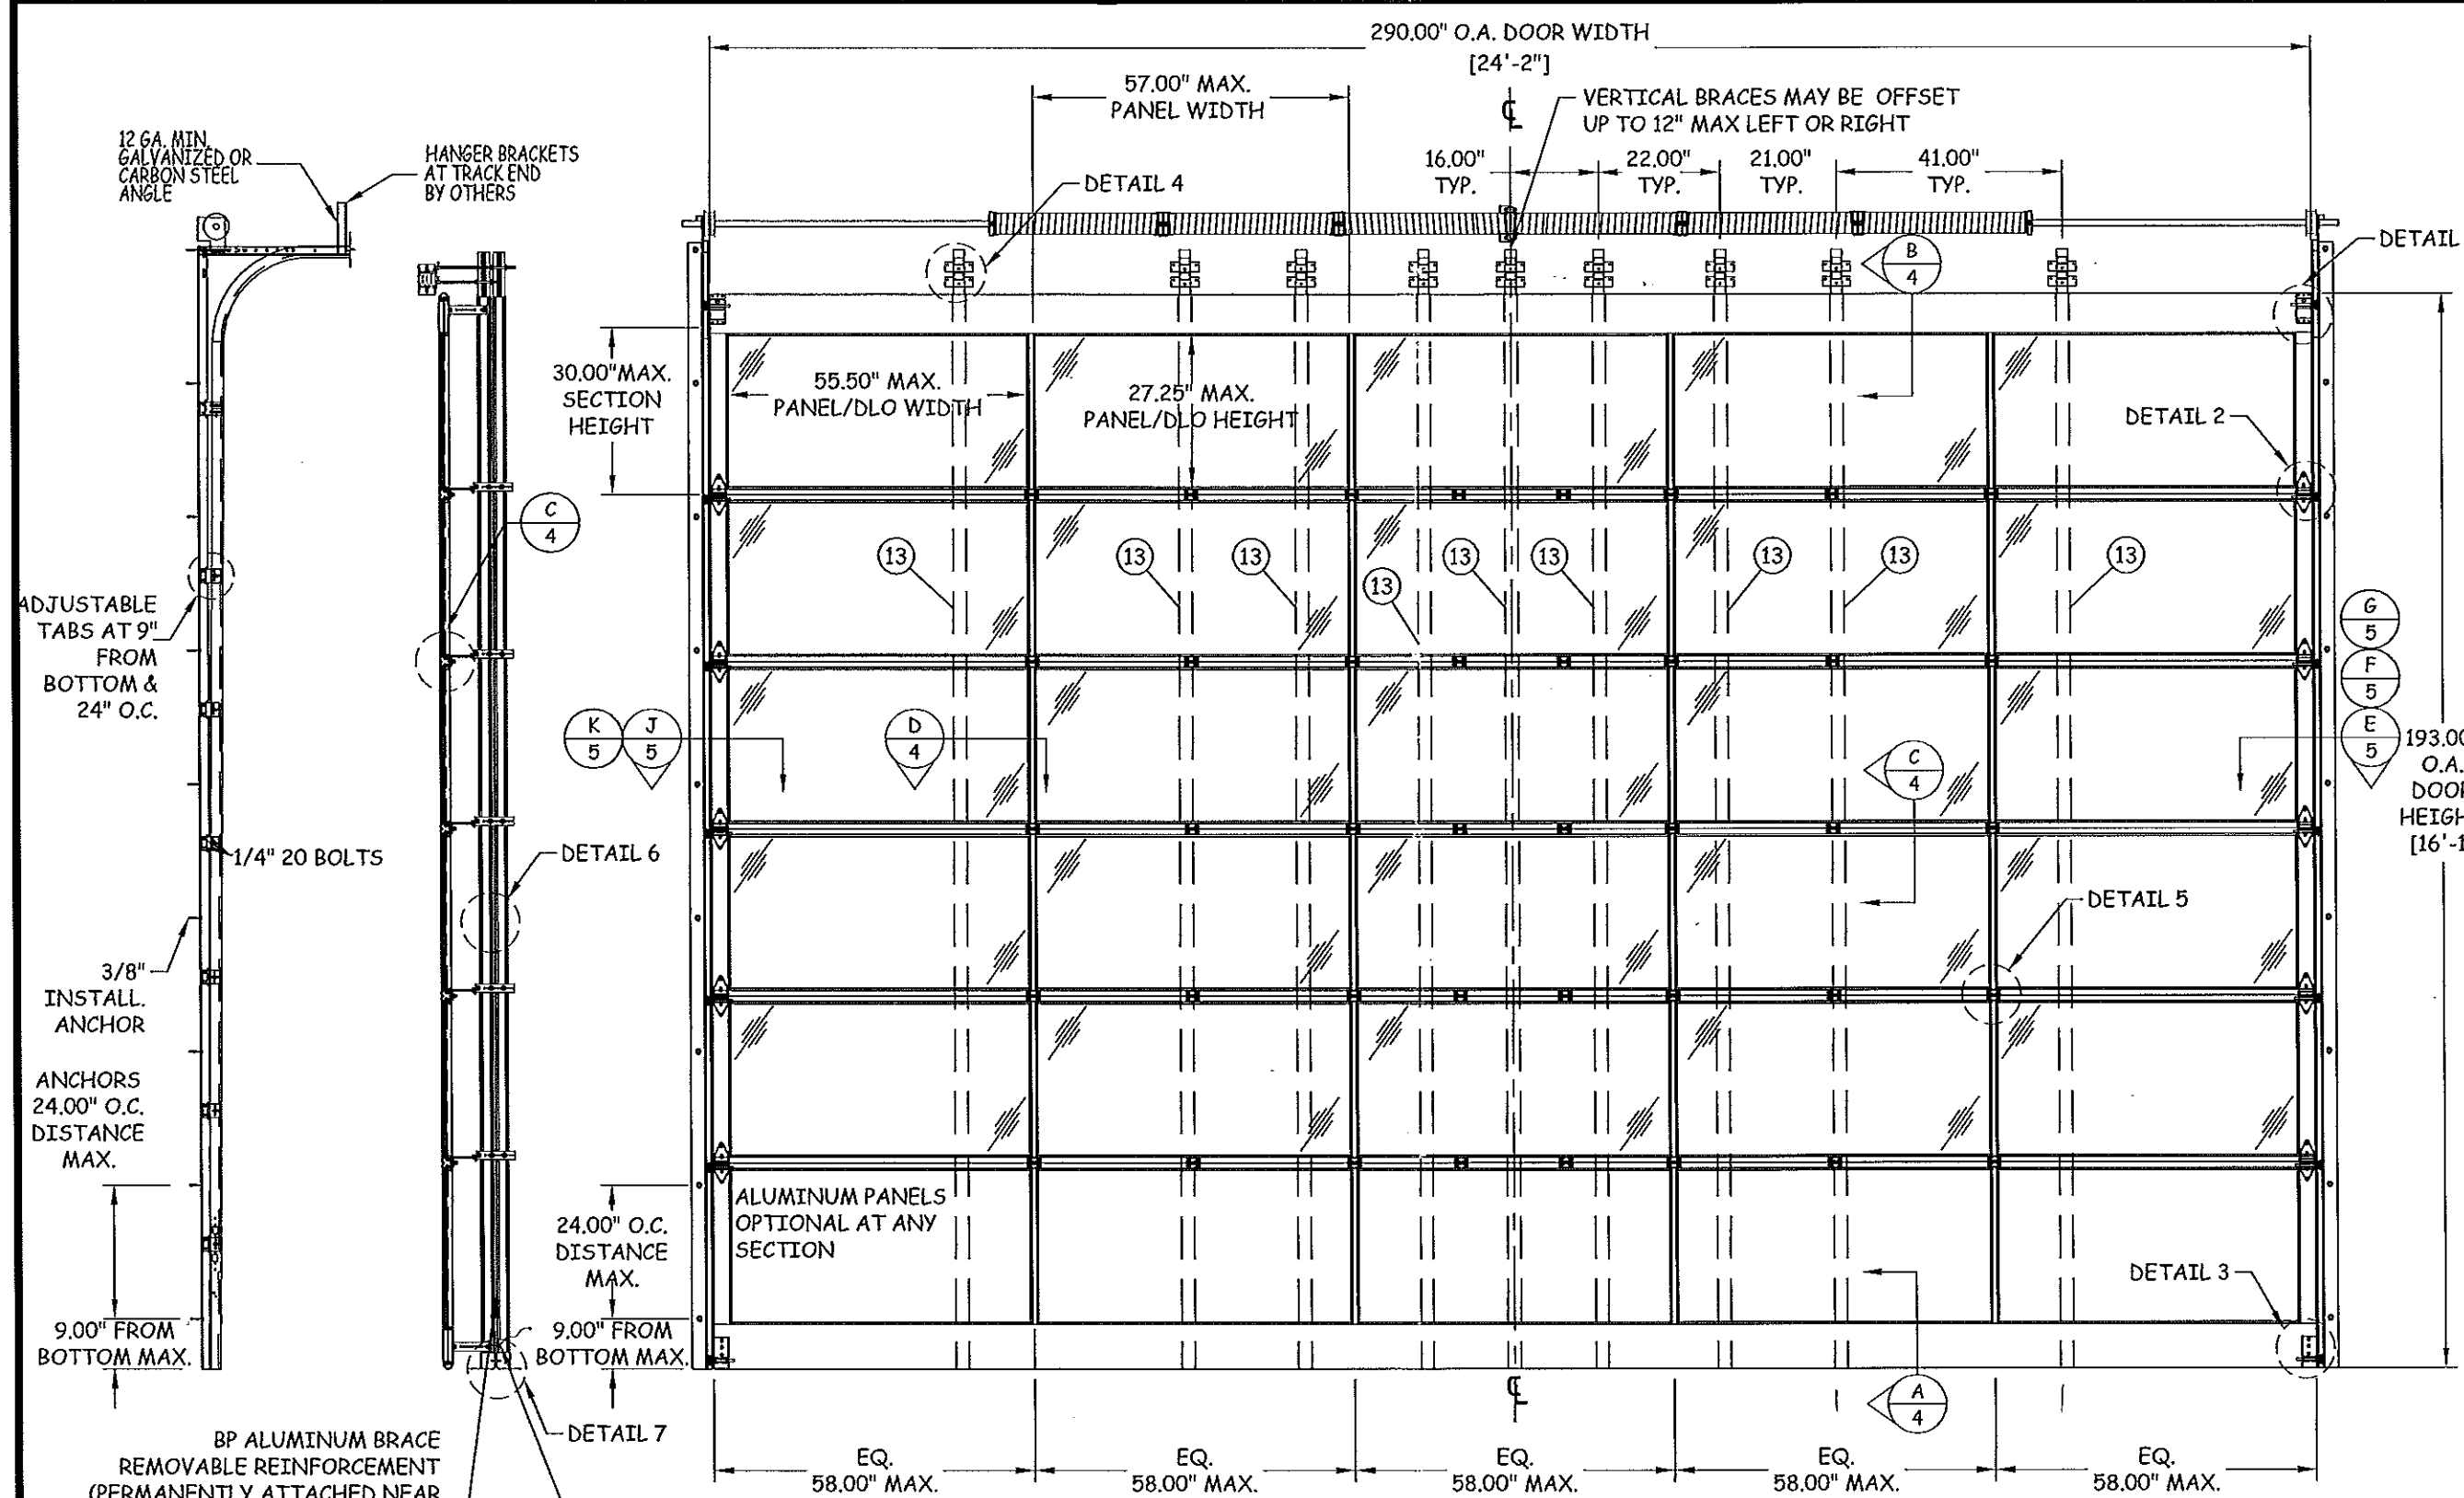

INTERIOR ELEVATION

SEE SHEET 3 FOR ALL NOTED DETAILS

ANCHOR LAYOUT

PRODUCT REVISED
to comply with the Florida
Building Code
Acceptance No. 14-0211.10
Expiration Date 2/11/2018
By *[Signature]*
Miami Dade Product Control



bp
BP-GLASS GARAGE DOORS & ENTRY
SYSTEMS, INC.
9412 GIDLEY STREET
TEMPLE CITY, CA 91780
PH: (626) 442-1716 FX: (626) 579-5320
www.GlassGarageDoors.com

TITLE: BP-450/550 HD
GLASS GARAGE DOOR
PATENTED HURRICANE SYSTEM
ELEVATION &
ANCHOR LAYOUT
PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
PH: (954) 399-8478 FX: (954) 744-4738


REVISIONS			
NO.	DESCRIPTION	BY	DATE
1	ANCHOR OPTIONS ADDED	TJM	10.4.13

[Signature]
HERNAN F. NORDRO, P.E.
FLORIDA P. E. NO. 73279
BUILDING SYSTEMS, INC.
398 DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
FBPE CERT. NO. AUTHORIZATION NO. 20576

DATE:	01.13.12	DWN BY:	JLA	CHK BY:	HFN	SCALE:	NTS
DWG #:	BPC005						
SHEET:	2 OF 8						

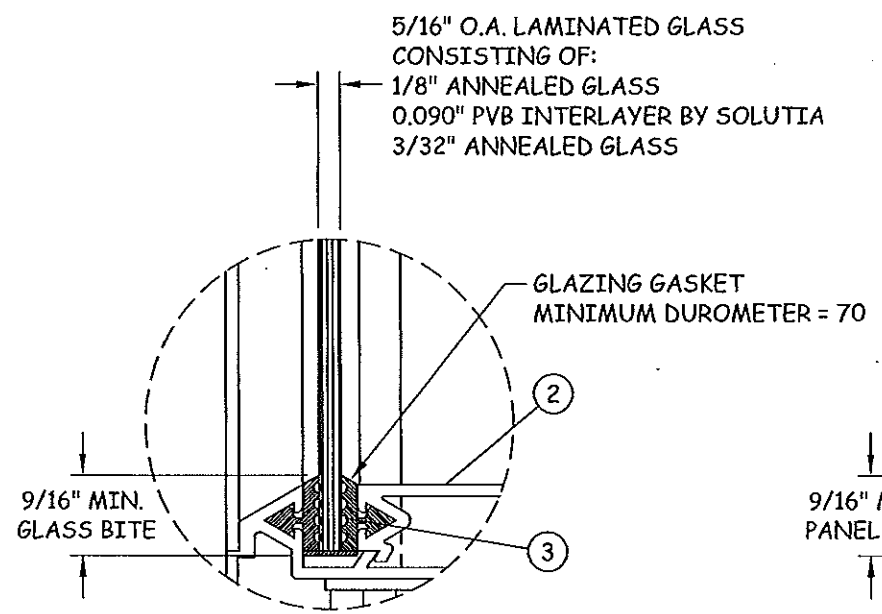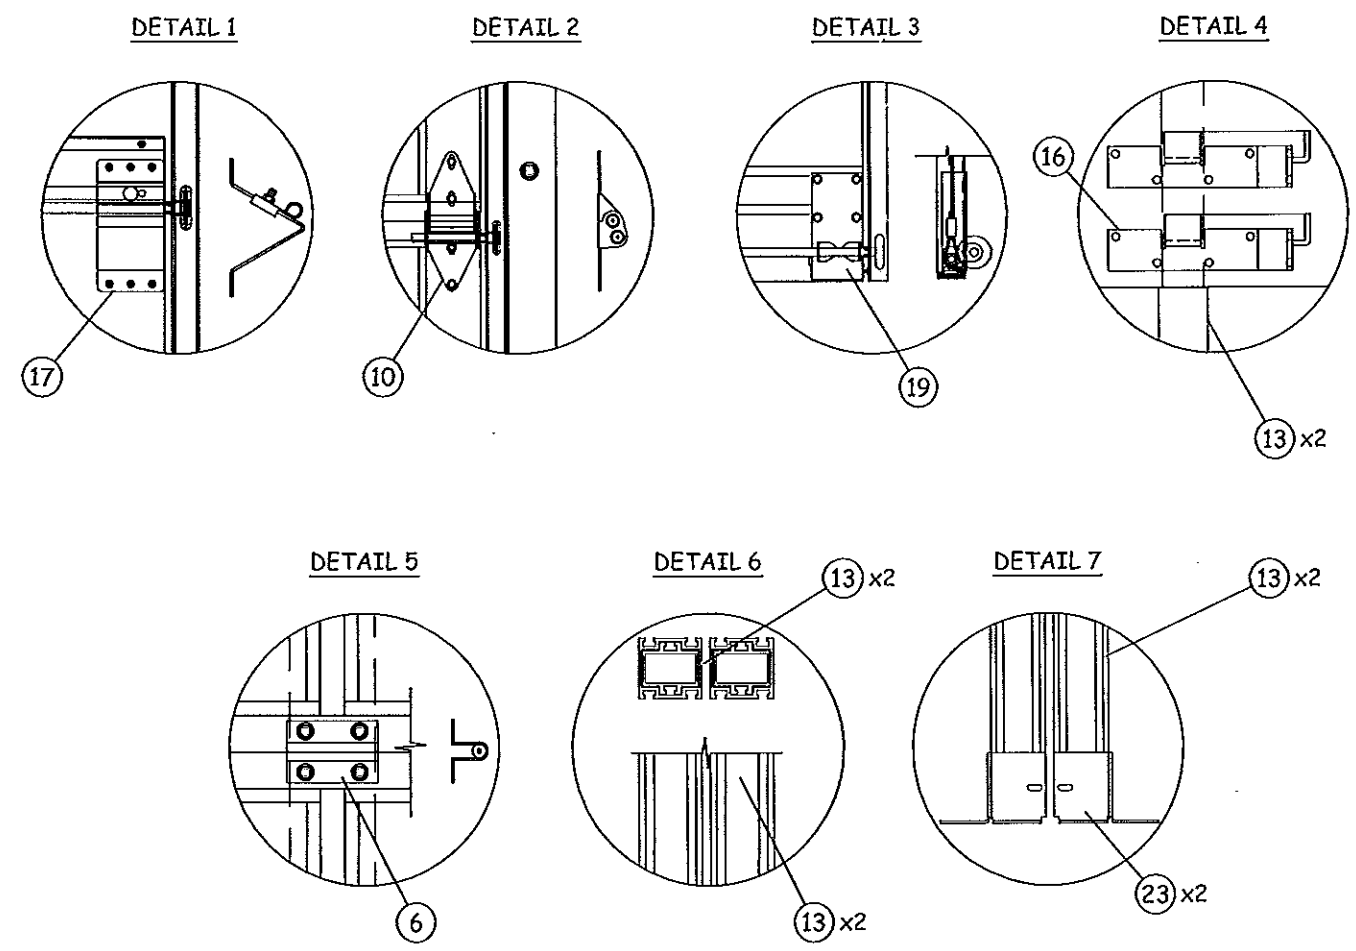

GLAZING DETAIL

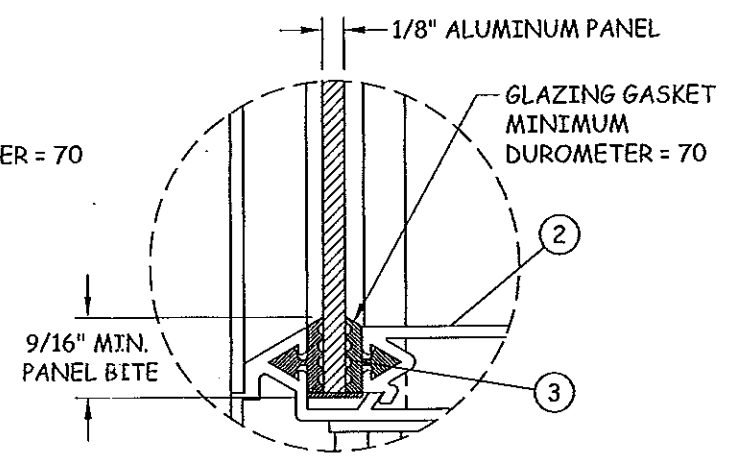

PANEL DETAIL



BP-GLASS GARAGE DOORS & ENTRY
SYSTEMS, INC.
9412 610LEY STREET
TEMPLE CITY, CA 91780
PH: (626) 442-1716 FX: (626) 579-5320
www.GlassGarageDoors.com

TITLE: BP-450/550 HD
GLASS GARAGE DOOR
PATENTED HURRICANE SYSTEM
ASSEMBLY DETAILS &
GLAZING DETAILS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
PH: (954) 399-8478 FX: (954) 744-4738


REVISIONS		
NO.	DESCRIPTION	DATE
A	ANCHOR OPTIONS ADDED	10.4.13

HERNANDEZ, P.E.
FLORIDA P.E. NO. 75778
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
FIDELITY & AUTHORITY INC. 20578


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 14-0211.10
Expiration Date 11/17/2018

By *[Signature]*
Miami Dade Product Control

DATE: 01.13.12	DWN BY: JLA	CHK BY: HFN	SCALE: NTS
DWG #: BPC005			
SHEET: 3 OF 8			

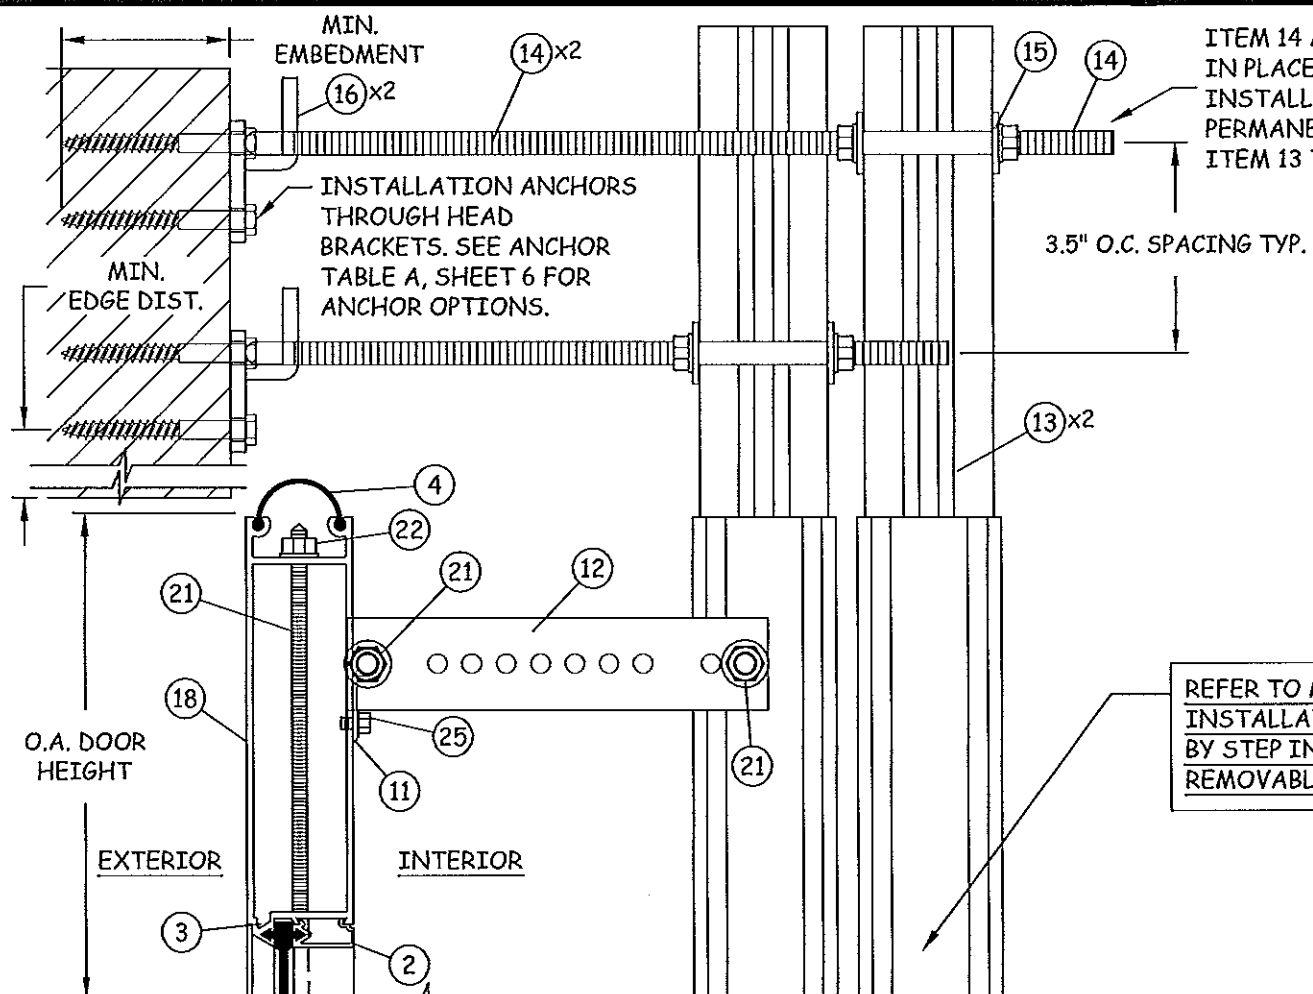

B
4 VERTICAL SECTION
TOP RAIL

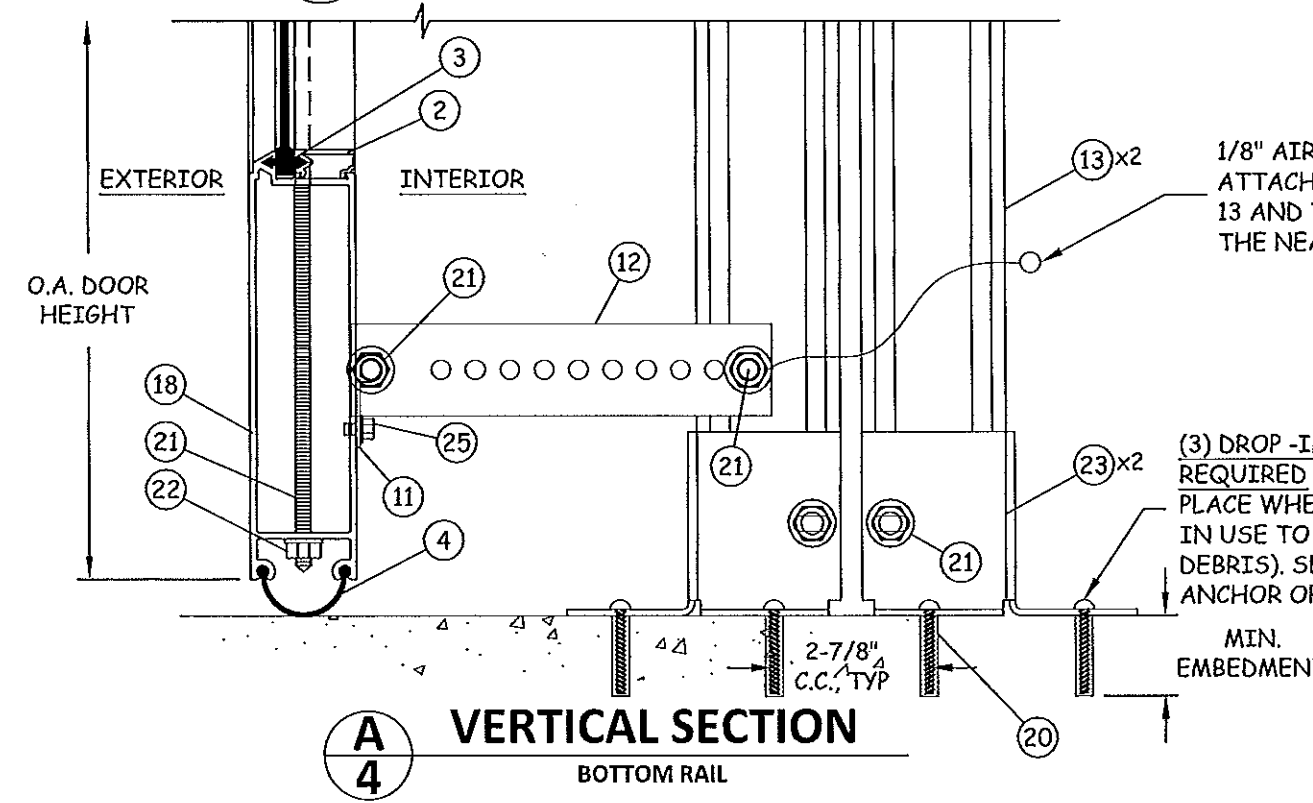


A
4 VERTICAL SECTION
BOTTOM RAIL


REFER TO MANUFACTURER'S
INSTALLATION MANUAL FOR STEP
BY STEP INSTRUCTION DETAILS ON
REMOVABLE REINFORCEMENT

ITEM 14 AND 15 ARE ADJUSTED
IN PLACE DURING FIRST
INSTALLATION, THEN REMAIN
PERMANENTLY ATTACHED TO
ITEM 13 THEREAFTER

ITEM 21 - THROUGH BOLT WITH WING
NUT (SCREW IN FINGER TIGHT AND KEEP
ATTACHED TO ITEM 12 DEFLECTION
BRACKETS WHEN REMOVABLE
REINFORCEMENT IS NOT IN USE)

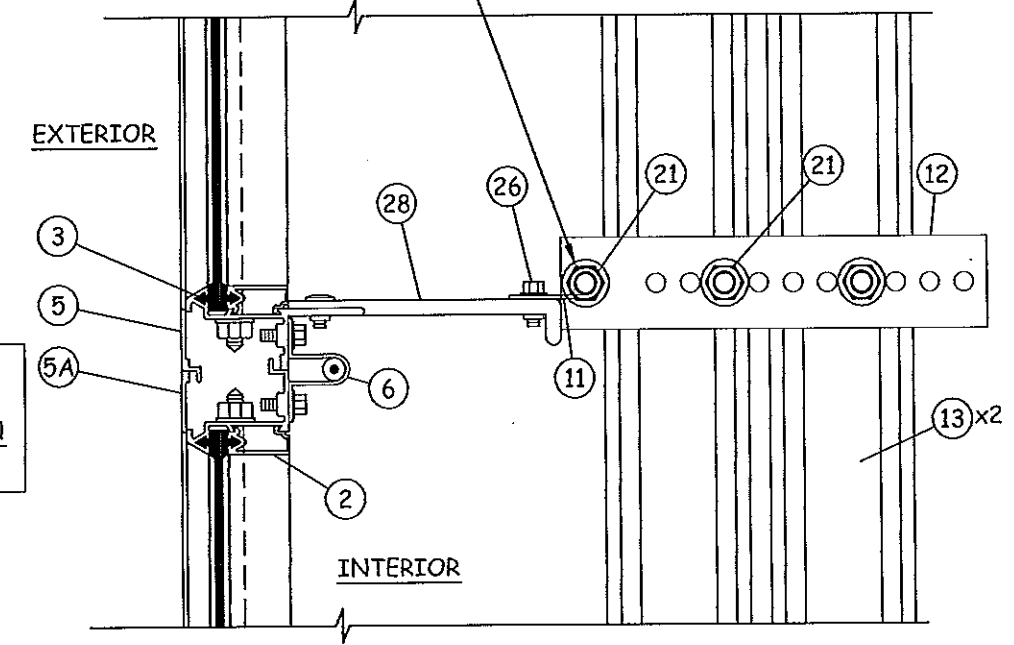

C
4 VERTICAL SECTION
INTERMEDIATE RAIL

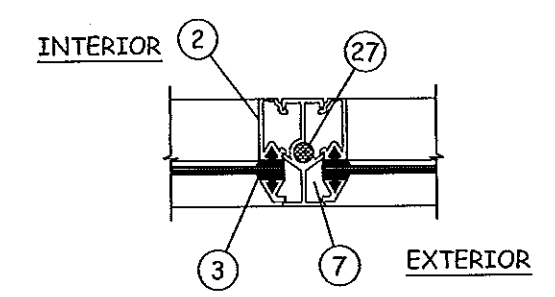

D
4 HORIZONTAL SECTION
VERTICAL MULLION

1/8" AIRCRAFT CABLE -
ATTACH ONE END TO ITEM
13 AND THE OTHER END TO
THE NEAREST SUBSTRATE.

(3) DROP-IN ANCHORS PER BOTTOM BRACKET
REQUIRED (SCREW IN FINGER TIGHT AND KEEP IN
PLACE WHEN REMOVABLE REINFORCEMENT IS NOT
IN USE TO KEEP HOLES FREE FROM DIRT AND
DEBRIS). SEE ANCHOR TABLE B, SHEET 6 FOR
ANCHOR OPTIONS.



BP-GLASS GARAGE DOORS & ENTRY
SYSTEMS, INC.
9412 GIBLEY STREET
TEMPLE CITY, CA 91780
PH: (626) 442-1716 FX: (626) 579-5320
www.GlassGarageDoors.com


TITLE: BP-450/550 HD
GLASS GARAGE DOOR
PATENTED HURRICANE SYSTEM
VERTICAL &
HORIZONTAL SECTIONS
PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
PH: (954) 399-8478 FX: (954) 744-4738

NO.	DESCRIPTION	BY	DATE
A	ANCHOR OPTIONS ADDED	TJM	10.4.13


1-27-2014
HERNAN F. MORENO, P.E.
FLORIDA P.E. NO. 73778
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
TYPE CERT. OF AUTHORIZATION NO. 13378

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 14-024-10
Expiration Date 01/17/2018
By *[Signature]*
Miami Dade Product Control


DATE: 01.13.12
DWN BY: JLA
CHK BY: HFN
SCALE: NTS
DWG #: BPC005
SHEET: 4 OF 8

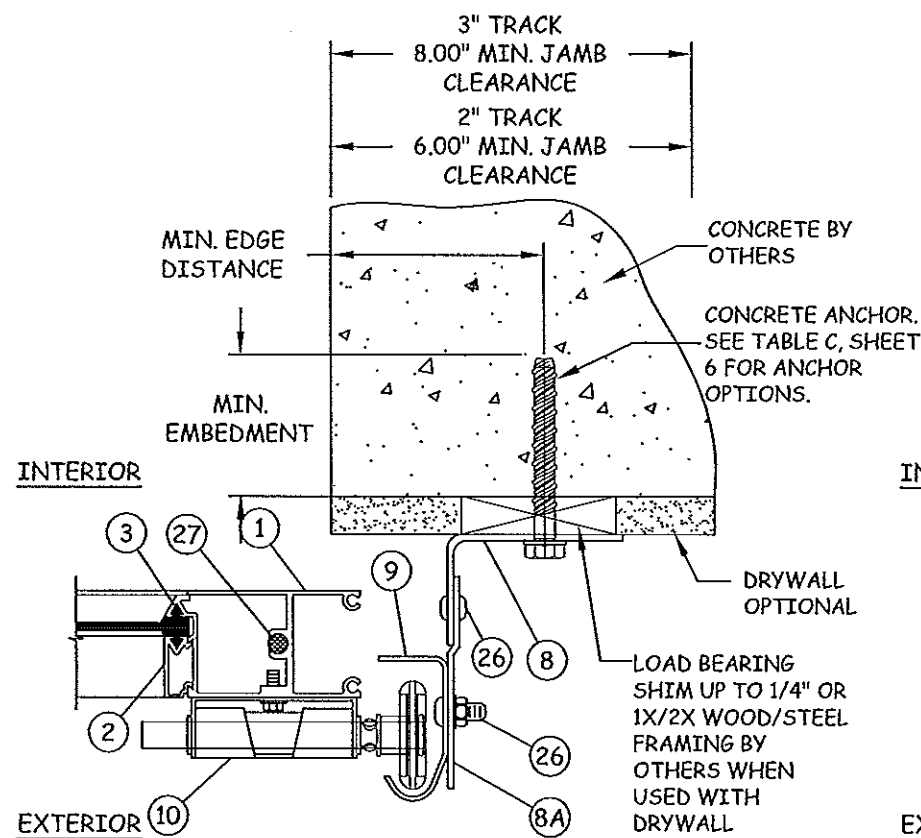


E
5 HORIZONTAL SECTION
JAMBS - DRYWALL OVER CONCRETE
ANGLE MOUNTED

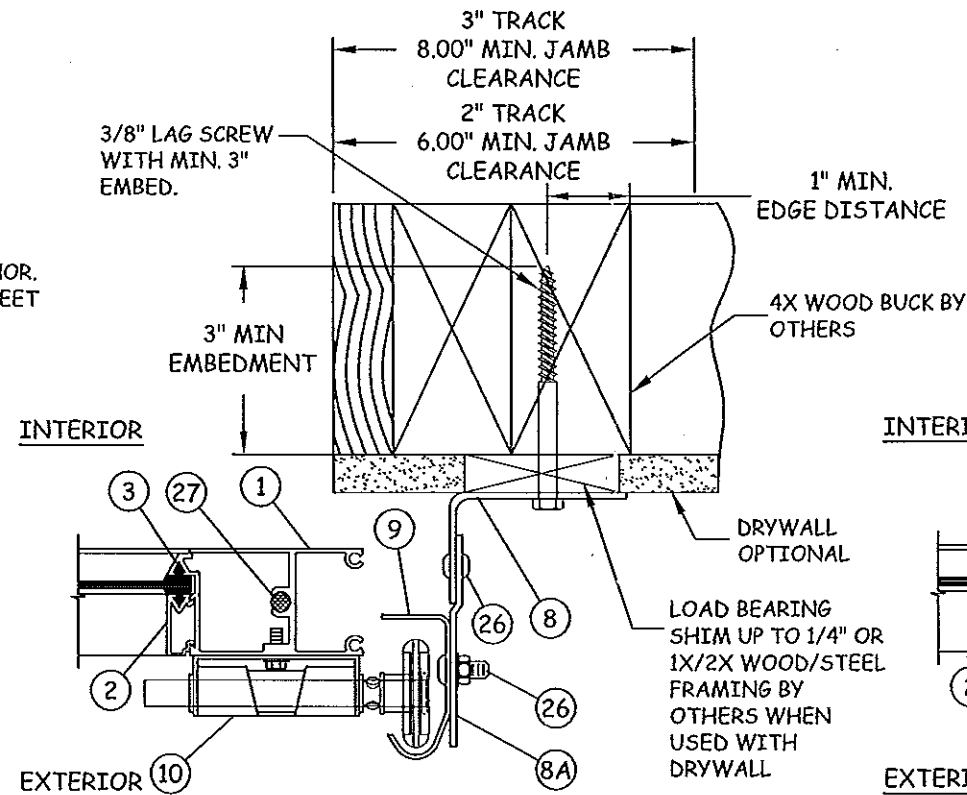


F
5 HORIZONTAL SECTION
JAMBS - DRYWALL OVER 4X WOOD FRAME
ANGLE MOUNTED

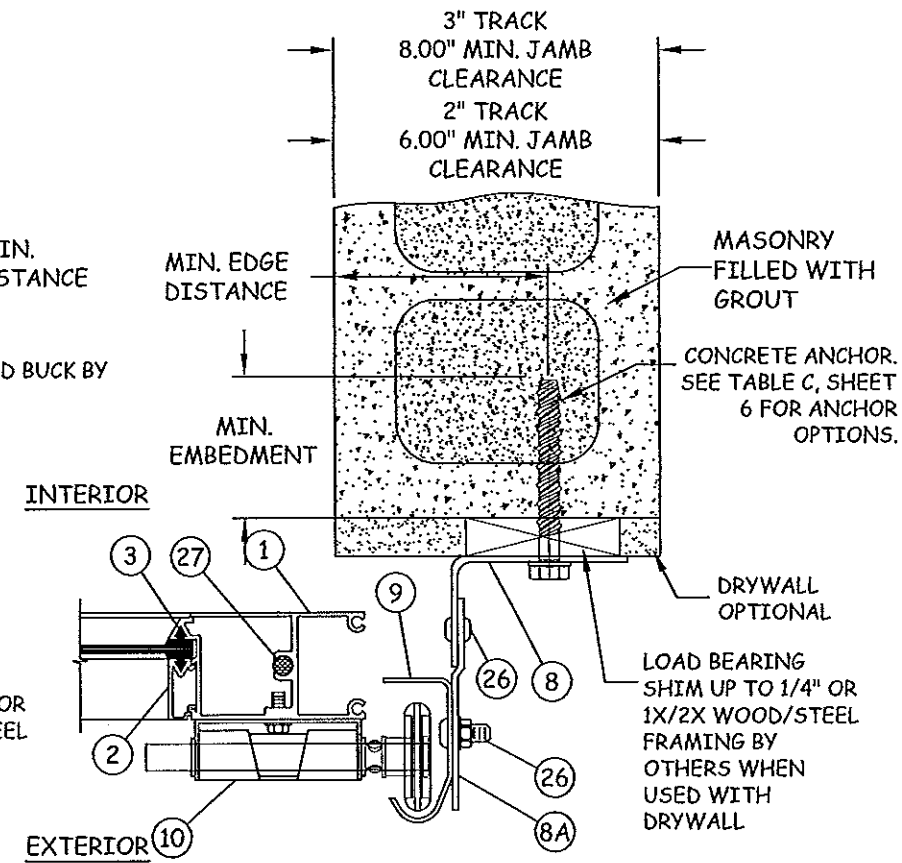

G
5 HORIZONTAL SECTION
JAMBS - DRYWALL OVER CMU
ANGLE MOUNTED

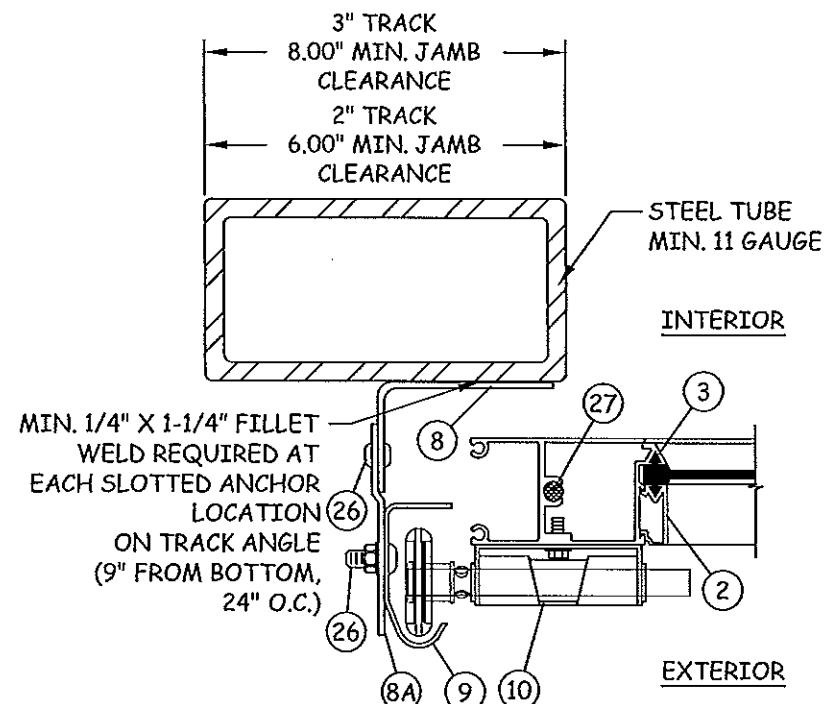

J
5 HORIZONTAL SECTION
JAMBS - STEEL
REVERSE ANGLE MOUNTED

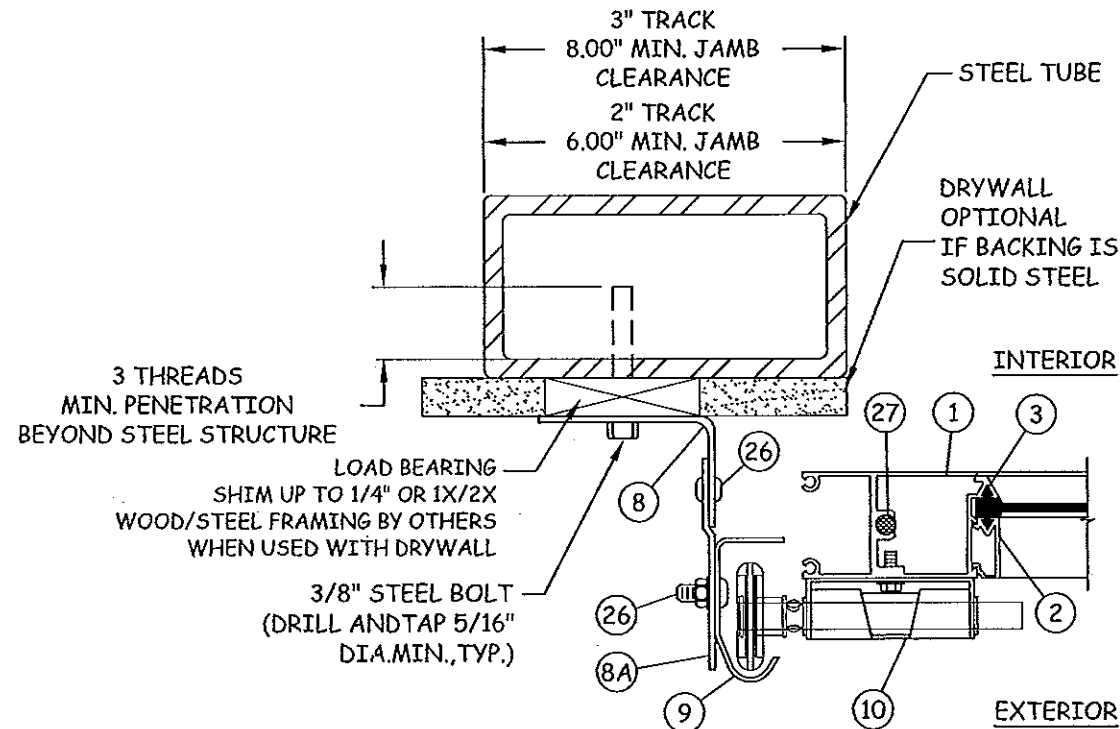

K
5 HORIZONTAL SECTION
JAMBS - STEEL W/ DRYWALL
ANGLE MOUNTED



BP-GLASS GARAGE DOORS & ENTRY
SYSTEMS, INC.
9412 GIDLEY STREET
TEMPLE CITY, CA 91780
PH: (626) 442-1716 FX: (626) 579-5320
www.GlassGarageDoors.com

TITLE: BP-450/550 HD
GLASS GARAGE DOOR
PATENTED HURRICANE SYSTEM
HORIZONTAL SECTIONS
PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
PH: (954) 399-8478 FX: (954) 744-4738

REVISIONS

NO.	DESCRIPTION	BY	DATE
A	ANCHOR OPTIONS ADDED	TJM	10.4.13

1-27-2014
HERNAN F. NUNEZ, P.E.
FLORIDA P.E. NO. 75778
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
FIFE CREDIT AUTHORIZATION NO. 28576


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 14-0211-10
Expiration Date 01/17/2018
By: *[Signature]*
Miami Dade Product Control

DATE: 01.13.12
DWN BY: JLA
CHK BY: HFN
SCALE: NTS
DWG #: BPC005
SHEET: 5 OF 8


Type	Anchor	Substrate	Embedment	Edge Distance	C.C. Distance
Epoxy	3/8" ITW Redhead A7	2000 psi concrete	3 3/8"	3 1/2"	3 1/2"
	3/8" Simpson AT	2000 psi concrete	1 3/4"	3"	3 1/2"
	3/8" Hilti HY150 MAX	2000 psi concrete	1 3/4"	3"	3 1/2"
Expansion	3/8" Hilti Kwik Bolt 3	3000 psi concrete	2 1/2"	3 1/2"	3 1/2"
	3/8" Hilti Kwik Bolt 3	grout filled CMU	2 1/2"	3 1/2"	3 1/2"
	3/8" ITW Redhead Wedge	2000 psi concrete	3"	3"	3 1/2"
	3/8" Powers Bolt Expansion	3000 psi concrete	2 1/2"	3 1/2"	3 1/2"
Tapcon/ Wedge Bolts	3/8" Redhead LDT	3000 psi concrete	2 1/2"	2"	3 1/2"
	3/8" Redhead LDT	grout filled CMU	2 1/2"	3 1/2"	3 1/2"
	3/8" Powers Wedge	2000 psi concrete	2 1/2"	3"	3 1/2"
	3/8" Powers Wedge	grout filled CMU	2 1/2"	3 1/2"	3 1/2"
	3/8" Simpson Titen HD	3000 psi concrete	2 3/4"	3 1/2"	3 1/2"
	3/8" Hilti Kwik HUS-EZ	3000 psi concrete	2 1/2"	3"	3 1/2"
Lag Screw	3/8" Lag Screw	Wood (min S.G. = 0.55)	3"	3 1/2"	-
		Steel (118 mills min. wall thickness)	3 threads penetration beyond steel structure	3/4"	-
Bolt	3/8" Steel Bolt	Steel (118 mills min. wall thickness)	3 threads penetration beyond steel structure	3/4"	-

- ALL ANCHOR TYPES LISTED ABOVE VALID FOR MIN. SPECIFIED SUBSTRATE OR GREATER
- ANCHOR OPTION MUST MEET MINIMUM EMBEDMENT, EDGE DISTANCE, AND C.C. DISTANCE SPECIFIED
- ANCHORAGE AT BRACKET MUST CONFORM TO APPLICABLE BRACKET DETAIL BELOW

ANCHOR TABLE A - HEADER

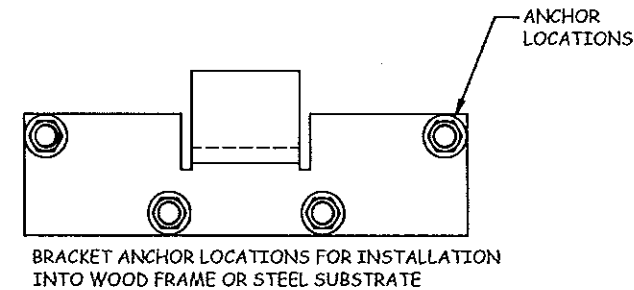

**BRACKET DETAIL A
(WOOD/STEEL INSTALLATION)**

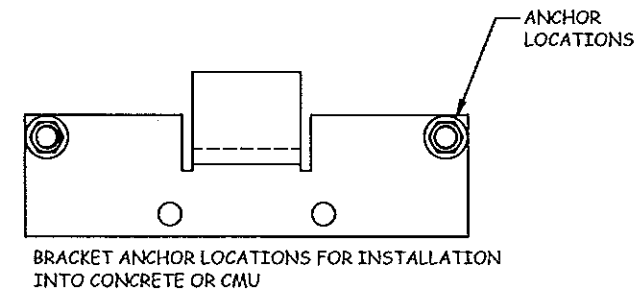

**BRACKET DETAIL B
(CONCRETE/CMU INSTALLATION)**

Type	Anchor	Substrate	Embedment	Edge Distance
Drop-In	3/8" Hilti HDI	2000 psi concrete	1 9/16"	3 1/8"
	3/8" ITW Redhead	2000 psi concrete	1 5/8"	2 7/8"
	3/8" Powers Smart DI+	3000 psi concrete	1 9/16"	4 1/2"

- ALL ANCHOR TYPES LISTED ABOVE VALID FOR MIN. SPECIFIED SUBSTRATE OR GREATER
- ANCHOR OPTION MUST MEET MINIMUM EMBEDMENT AND EDGE DISTANCE SPECIFIED

ANCHOR TABLE B - SILL

Type	Anchor	Substrate	Embedment	Edge Distance
Drop-In	3/8" Hilti HDI	2000 psi concrete	1 9/16"	3 1/2"
	3/8" ITW Redhead	2000 psi concrete	1 5/8"	2 7/8"
	3/8" Powers Smart DI+	3000 psi concrete	1 9/16"	3 1/2"
Epoxy	3/8" ITW Redhead A7	2000 psi concrete	3 3/8"	3 1/2"
	3/8" Simpson AT	2000 psi concrete	1 3/4"	3"
	3/8" Hilti HY150 MAX	2000 psi concrete	1 3/4"	3"
Expansion	3/8" Hilti Kwik Bolt 3	3000 psi concrete	2 1/2"	3 1/2"
	3/8" Hilti Kwik Bolt 3	grout filled CMU	2 1/2"	3 1/2"
	3/8" ITW Redhead Wedge	2000 psi concrete	3"	3"
	3/8" Powers Bolt Expansion	3000 psi concrete	2 1/2"	3 1/2"
Tapcon/ Wedge Bolts	3/8" Redhead LDT	3000 psi concrete	1 1/2"	2"
	3/8" Redhead LDT	grout filled CMU	1 1/2"	3 1/2"
	3/8" Powers Wedge	2000 psi concrete	2 1/2"	3"
	3/8" Powers Wedge	grout filled CMU	2 1/2"	3 1/2"
	3/8" Hilti Kwik HUS-EZ	3000 psi concrete	2 1/2"	3"
	3/8" Hilti Kwik HUS-EZ	grout filled CMU	1 5/8"	4"
Lag Screw	3/8" Lag Screw	Wood (min S.G. = 0.55)	3"	3 1/2"
Bolt	3/8" Steel Bolt	Steel (118 mills min. wall thickness)	3 threads penetration beyond steel structure	3/4"

- ALL ANCHOR TYPES LISTED ABOVE VALID FOR MIN. SPECIFIED SUBSTRATE OR GREATER
- ANCHOR OPTION MUST MEET MINIMUM EMBEDMENT AND EDGE DISTANCE SPECIFIED

ANCHOR TABLE C - TRACK

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2014.04.18 12:02:22 -04'00'

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 14-0211.10
Expiration Date 2/17/2018
By *[Signature]*
Miami Dade Product Control

bp
BP-GLASS GARAGE DOORS & ENTRY
SYSTEMS, INC.
9412 MIDLEY STREET
TEMPLE CITY, CA 91780
PH: (626) 442-1716 FX: (626) 579-5320
www.GlassGarageDoors.com








TITLE: BP-450/550 HD
GLASS GARAGE DOOR
PATENTED HURRICANE SYSTEM
ANCHOR TABLES &
BRACKET DETAIL
PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
PH: (954) 399-8478 FX: (954) 744-4738

NO.	DESCRIPTION	BY	DATE	ANCHOR OPTIONS ADDED
A		TJM	10.4.13	

HERMES F. NORERO
LICENSE
No. 73778
STATE OF
FLORIDA
REGISTERED PROFESSIONAL ENGINEER
EXPIRATION DATE 12/31/2018
FPE CERT. AUTHORIZATION NO. 28578

DATE: 01.13.12
DWN BY: JLA
CHK BY: HFN
SCALE: NTS
DWG #: **BPC005**
SHEET: **6 OF 8**

BILL OF MATERIALS			
ITEM NO.	DESCRIPTION	MATERIAL	MANUFACTURER
1	350 SIDE FRAME RAIL	ALUMINUM	BP GLASS DOORS
2	GLASS STOP	ALUMINUM	BP GLASS DOORS
3	GLAZING GASKET	EPDM	GLS
4	WEATHERSTRIPPING	EPDM	GLS
5	INTERMEDIATE RAIL (UPPER)	ALUMINUM	BP GLASS DOORS
5A	INTERMEDIATE RAIL (LOWER)	ALUMINUM	BP GLASS DOORS
6	INTERMEDIATE HINGE	0.083" THK. STAINLESS STEEL	BP GLASS DOORS
7	VERTICAL MULLION	ALUMINUM	BP GLASS DOORS
8	ANGLE	12 GA. STEEL	BP GLASS DOORS
8A	ADJUSTABLE TAB	12 GA. STEEL	BP GLASS DOORS
9	TRACK 2"	15 GA. STEEL	BP GLASS DOORS
10	UNIVERSAL HINGES	12 GA. STAINLESS STEEL	BP GLASS DOORS
11	HF-PIN BRACKET	12 GA. STAINLESS STEEL	BP GLASS DOORS
12	DEFLECTION BRACKET	11 GA. G-90 GALV. STEEL	BP GLASS DOORS
13	REMOVABLE REINFORCEMENT	1/8" THK. ALUMINUM	BP GLASS DOORS
14	3/8" U-BOLT & LOCK NUTS	STEEL	BP GLASS DOORS
15	U-BOLT PLATES	12 GA. GALV. STEEL	BP GLASS DOORS
16	TOP BRACKET	1/4" STEEL	BP GLASS DOORS
17	TOP FIXTURE	1/8" THK. STAINLESS STEEL	BP GLASS DOORS
18	450/550 TOP AND BOTTOM RAIL	ALUMINUM	BP GLASS DOORS
19	BOTTOM FIXTURE	1/8" THK. STAINLESS STEEL	BP GLASS DOORS
20	3/8" DROP IN CONCRETE ANCHOR	STEEL	BP GLASS DOORS
21	1/4" - 20 HEX BOLT & NUTS	STEEL	BP GLASS DOORS
22	1/4" NUT	STEEL	BP GLASS DOORS
23	FLOOR FLANGE	0.134" THK. G-90 GALV. STEEL	BP GLASS DOORS
24	3/8" X 3" LAG BOLT	STEEL	BP GLASS DOORS
25	1/4" X 1/2" SELF THREADING SCREW	STEEL	BP GLASS DOORS
26	1/4" X 1/2" CARRIAGE BOLT	STEEL	BP GLASS DOORS
27	1/4" X 20 GALV. THRU BOLT W/ NUT	STEEL	BP GLASS DOORS
28	REINFORCING STRUT	1/4" THK. ALUMINUM	BP GLASS DOORS

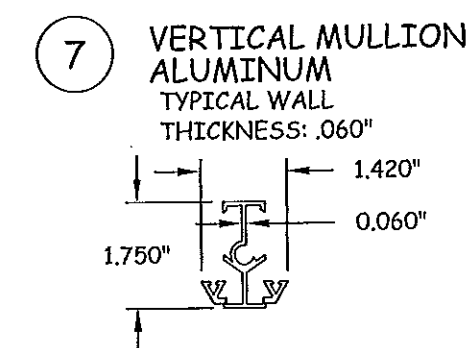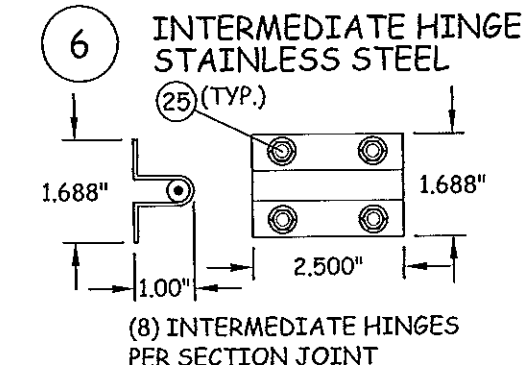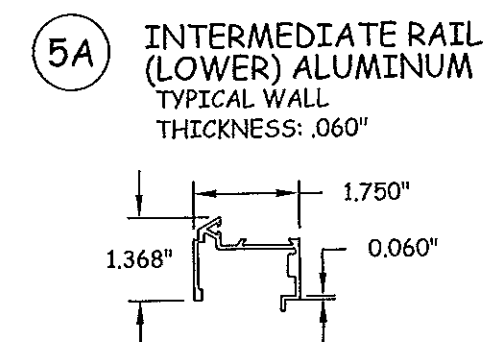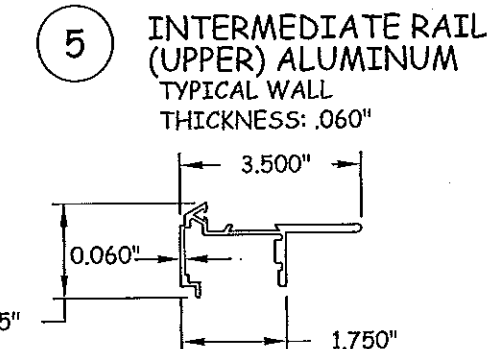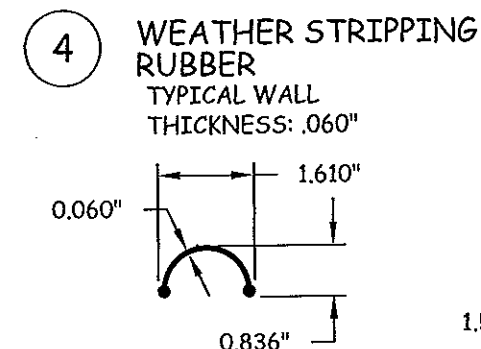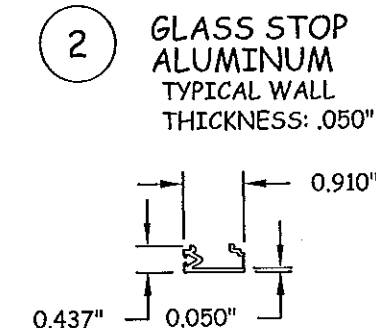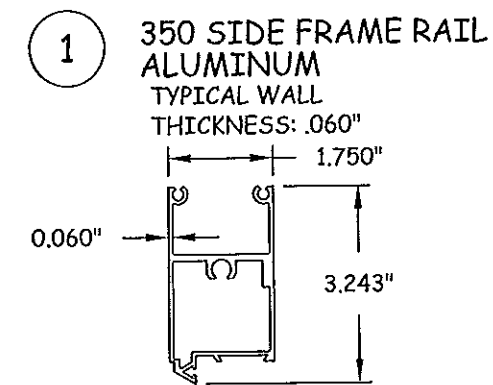

BP-GLASS GARAGE DOORS & ENTRY
SYSTEMS, INC.
9412 GIDLEY STREET
TEMPLE CITY, CA 91780
PH: (626) 442-1716 FX: (626) 579-5320
www.GlassGarageDoors.com


TITLE: BP-450/550 HD
GLASS GARAGE DOOR
PATENTED HURRICANE SYSTEM
COMPONENTS &
BILL OF MATERIALS
PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
PH: (954) 399-8478 FX: (954) 744-4738

REVISIONS		DATE	BY
NO.	DESCRIPTION	ANCHOR OPTIONS ADDED	
A			TJM 10.4.13

1-27-2014
HERMES F. NORCRO, P.E.
FLORIDA P. E. NO. 72778
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
FBPE CERT. OF AUTHORIZATION NO. 29578

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 14-0211.10
Expiration Date 2/17/2018
By *[Signature]*
Miami Trade Product Control

DATE: 01.13.12
DWN BY: JLA
CHK BY: HFN
SCALE: NTS
DWG #: BPC005
SHEET: 7 OF 8

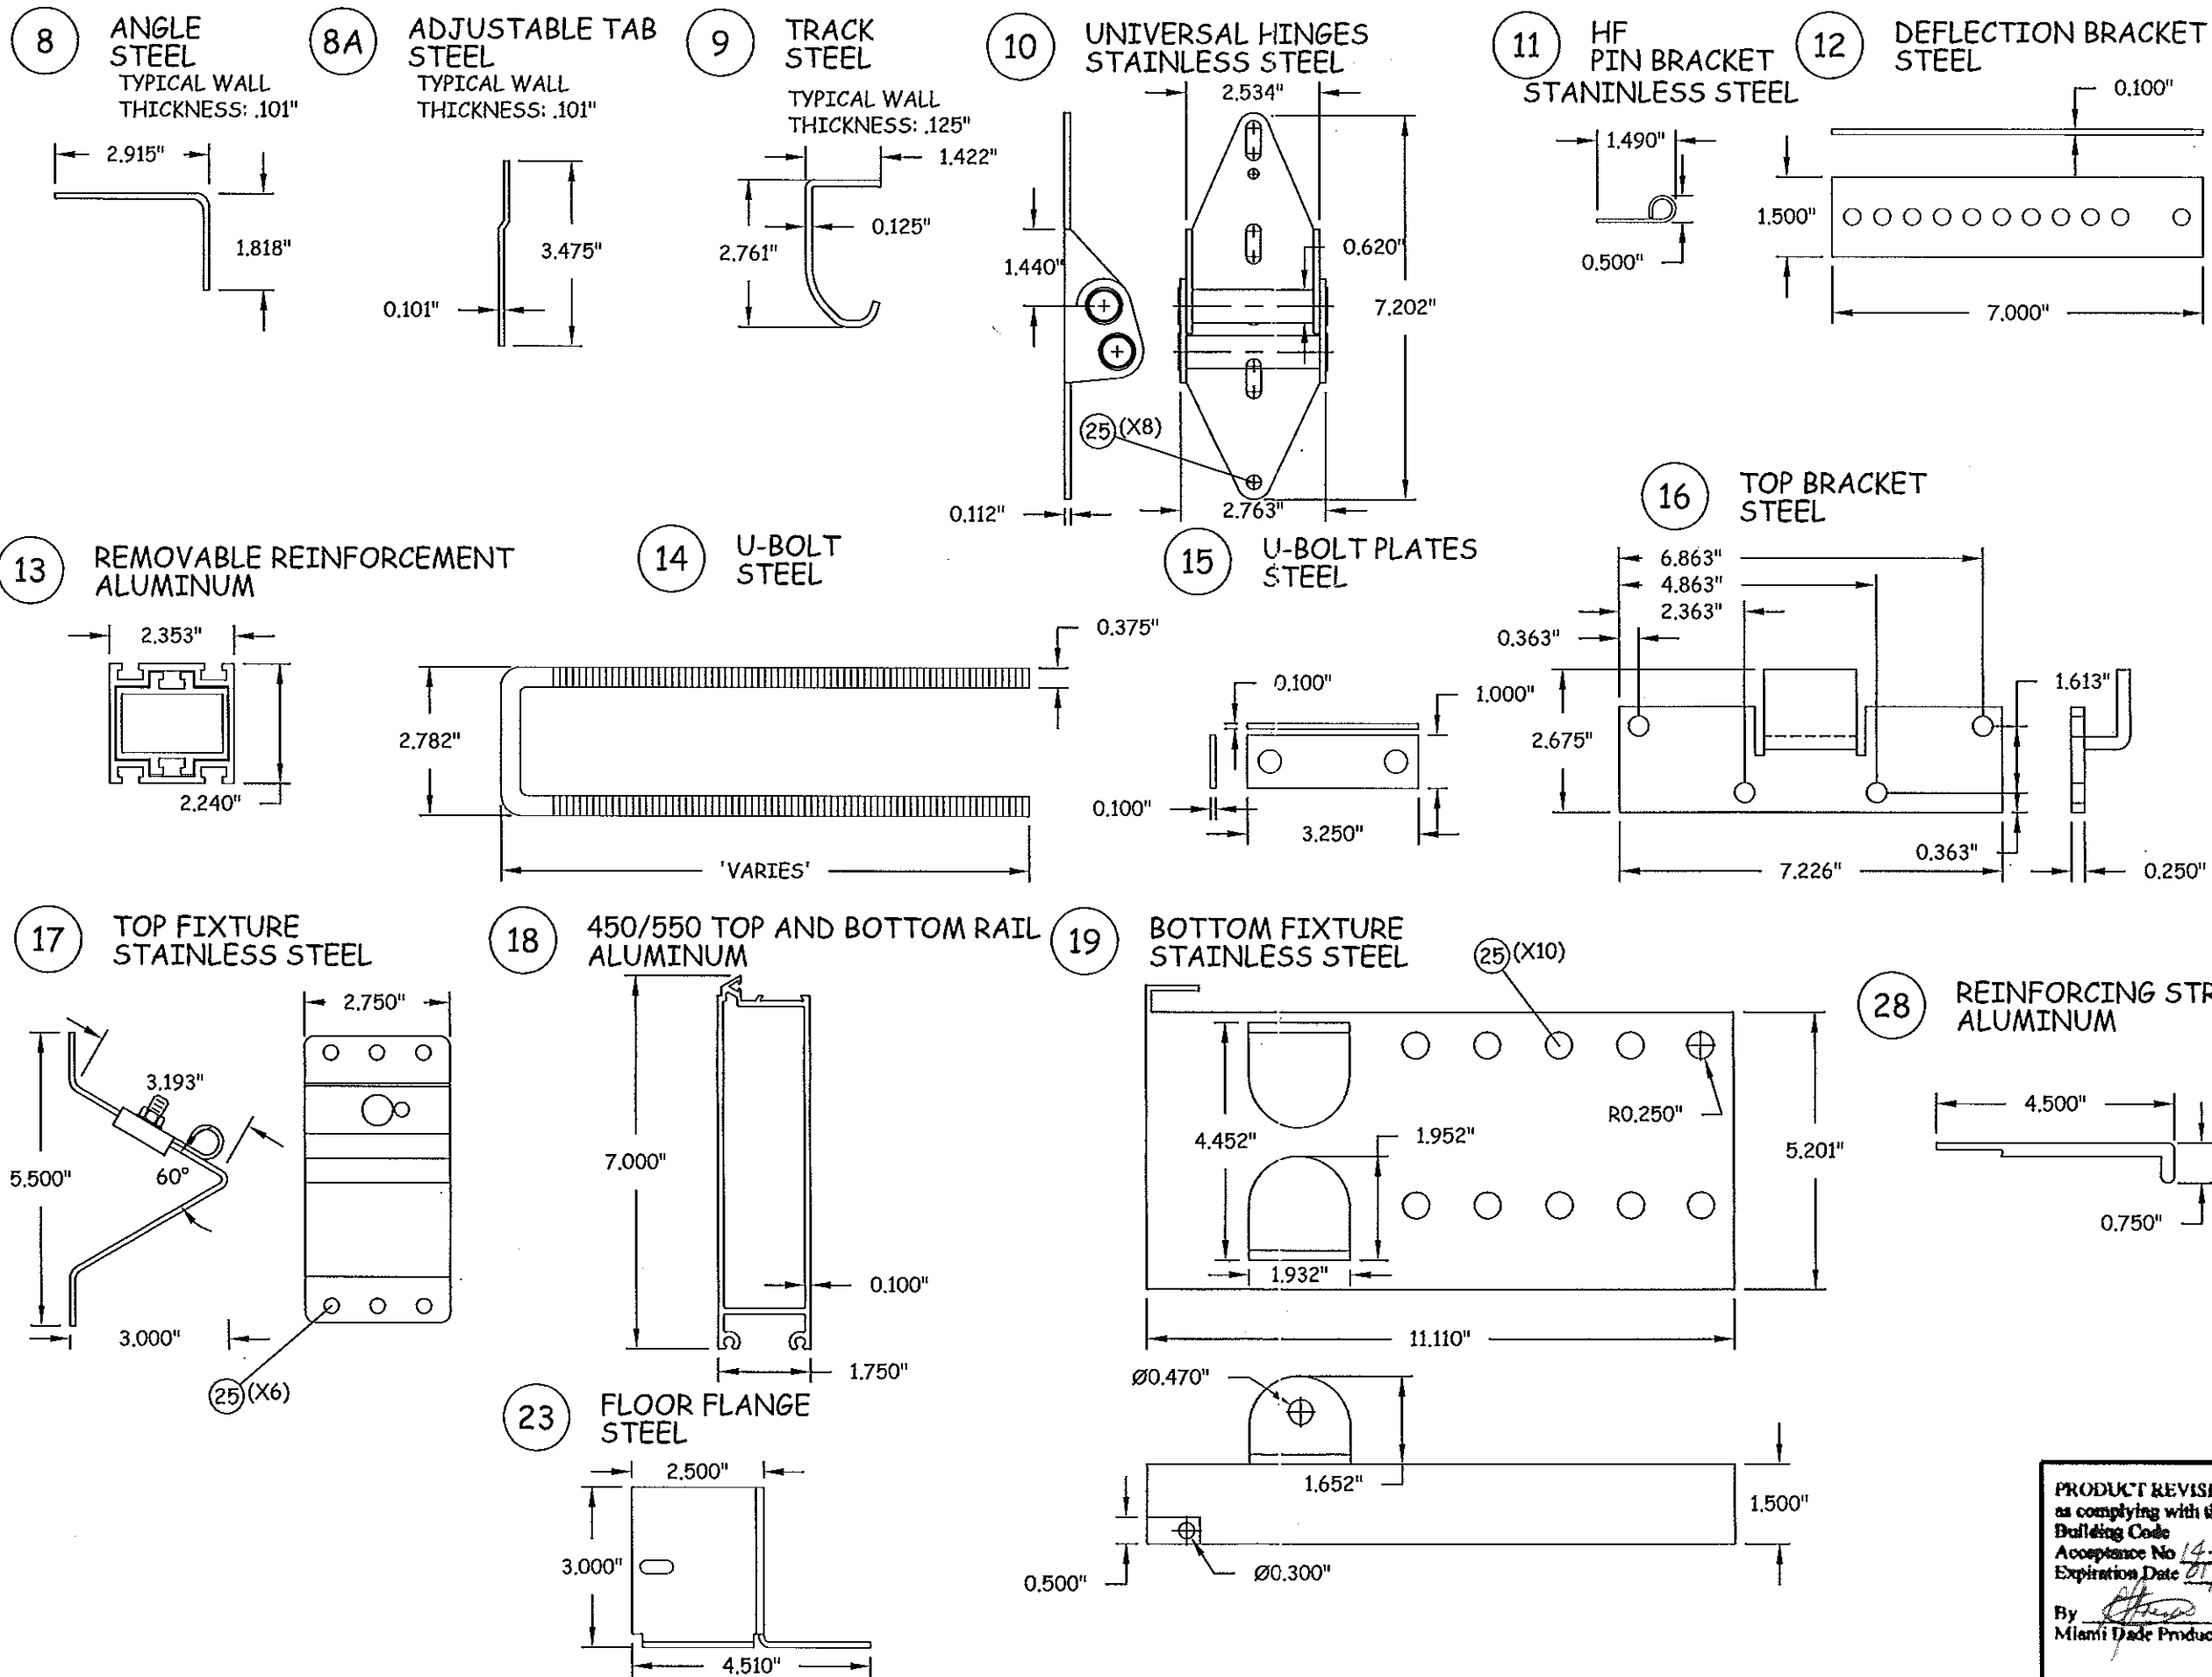

BP-GLASS GARAGE DOORS & ENTRY
SYSTEMS, INC.
9412 GIDLEY STREET
TEMPLE CITY, CA 91780
PH: (626) 442-1716 FX: (626) 579-5320
www.GlassGarageDoors.com

TITLE: BP-450/550 HD
GLASS GARAGE DOOR
PATENTED HURRICANE SYSTEM
COMPONENTS

PREPARED BY:
BUILDING DROPS, INC.
398 E. DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
PH: (954) 399-8478 FX: (954) 744-4738

REVISIONS		DESCRIPTION	BY	DATE
NO.	A	ANCHOR OPTIONS ADDED	TJM	10.4.13

1-27-2014
HERMES F. NORRERO, P.E.
FLORIDA P.E. NO. 73770
BUILDING DESIGN, INC.
398 E. DANIA BEACH BLVD. #338
DANIA BEACH, FL 33004
PERMIT TO CONSTRUCTION NO. 20575

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 14-0211.10
Expiration Date 01/17/2018

By: *[Signature]*
Miami Made Product Control

DATE: 01.13.12
DWN BY: JLA
CHK BY: HFN
SCALE: NTS

DWG #: BPC005
SHEET: 8 OF 8